


"Welcome to the K Controls e-training course designed to deliver useful "Pneumatic Valve Actuation" application information in small instalments."

To unsubscribe or to register a colleague to receive these documents [Click here](#)

Position Transmitters

Main uses

Position Transmitters are used to monitor the position of modulating control valves or the opening and closing characteristics of critical isolating valves. The information from the transmitter can then be used to diagnose valve performance in order to warn of the requirement for early preventative maintenance or to automatically adjust various control parameters in the positioner or controller. The ultimate objective is to improve process quality and increase plant throughput. Deteriorating valve performance can also lead to environmentally damaging fugitive emissions.

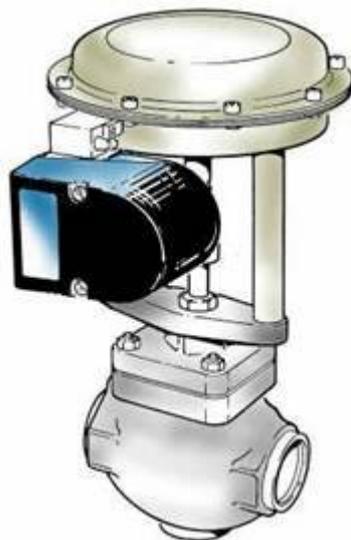

Closed control loops will try to compensate for deteriorating valve performance but eventually it will be impossible to maintain a given set point. Backlash in mechanical linkages and stiction in valve glands and seats can be detected by tracing the valves response to a changing input signal. The trace of the valves actual position relative to a steadily increasing input signal can be recorded when the valve is new and then compared to other movement traces recorded throughout its life. It is also possible to check that a control valve has been sized properly when first installed. For example if a valve is only controlling by spending most of its time close to the fully open or fully closed positions it is likely that it is too large or too small and control will be compromised.

Speed of response, hunting or overshoot can also be monitored with a position transmitter. If a control valve responds to a signal change too slowly, hunts or overshoots the desired position significantly before settling into control, then process quality and overall system performance will suffer. Signal increments need to be greater than those used when testing for backlash or stiction. Speed, hunting and overshoot problems could imply air leakage, incorrect actuator sizing or inappropriate positioner gain settings. It is also possible to use the position transmitter to trace valve position against flow rate. A control valve can continue to function well without backlash, stiction, actuator or positioner problems but gradual wear of the plug and seat in the valve or a build up of deposits in the valve or surrounding pipework can affect performance of the control loop.

Similar movement traces can be produced for critical isolating valves. Limit switches can confirm that the desired position has been reached but a position transmitter can determine if the valve is moving smoothly or hesitating somewhere in mid travel.

Limit switches in a position transmitter

Limit switches can also be fitted in a position transmitter. A valve will no longer control when it is fully open or closed although the control loop will keep trying.



E-training

K Controls designs and manufactures valve networking monitoring and control products:

Switchboxes
Control Monitors
Position Transmitters
Corrosion resistant
ATEX certified – gas + dust
High and low temperatures
IP68 for submersion
Low powered solenoids
Remote I/O compatible
AS-interface®
DeviceNet™
PROFIBUS® PA
FOUNDATION™ FIELDBUS
4-20mA + HART®
Wireless solutions
Linear or rotary adaptation

K Controls can also supply your positioner requirements

This can cause the control algorithm to “wind-up”. This in turn can cause the valve to oscillate for a while even when the process variable returns to the controllable range. Some controllers can adjust the algorithm to eliminate control “wind-up” when end of travel is detected via the limit switches.

The main types of position transmitter

There are a number of different types of position transmitter. The simplest is a potentiometer driven from the actuator via a gear set. A voltage is applied across the varying resistance of the potentiometer and the resultant current is measured to determine valve position. The potentiometer can be gear driven through a clutch drive system which prevents damage to the potentiometer and gears through over travel of the input shaft. Limit stops are provided within the drive to ensure the wiper in the potentiometer remains within the limits of electrical rotation. The range of resistive output will be a ratio of the mechanical rotation to the electrical rotation. Temperature and the length of interconnecting cable can affect the resistance of the device and for this reason it is recommended the potentiometer be used as a voltage divider to eliminate the effects of these fluctuations. To avoid the effects of ambient electrical disturbance, screened cables are recommended when connecting the potentiometer to the associated equipment. When adapting to linear applications lever arm linkage systems are often used and this conversion from linear to rotary motion will have some effect on the linearity of the device. This rarely has any practical impact on the performance of a control loop. Backlash in the mechanism can be limited by including a spring within the lever arm that reduces the tolerances in the linkage.

LVDTs and RVDTs Linear and Rotary Variable Differential Transformers can be used in place of potentiometers. They are accurate and as they do not have contacting surfaces they are not affected by vibration. However they tend to be expensive and difficult to adapt from one application to another.

An “optical encoder” driven transmitter senses position optically via an LED shining through a slotted disk. Output is rarely affected by vibration or temperature. They are expensive and consume a lot of power. They do not give instantaneous output values. Condensation on the disk at low temperatures can be a problem.

“Hall effect” transmitters use a magnetic coupling and accuracy is variable. They do not have contacting surfaces so there is little if any wear due to vibration.

The addition of a resistance-to-current transducer circuit in the enclosure with the potentiometer can overcome many of the problems associated with varying lengths of interconnecting cable.



E-training

K Controls designs and manufactures valve networking monitoring and control products:

Switchboxes
Control Monitors
Position Transmitters
Corrosion resistant
ATEX certified – gas + dust
High and low temperatures
IP68 for submersion
Low powered solenoids
Remote I/O compatible
AS-interface®
DeviceNet™
PROFIBUS® PA
FOUNDATION™ FIELDBUS
4-20mA + HART®
Wireless solutions
Linear or rotary adaptation

K Controls can also supply your positioner requirements



A stainless steel EExia intrinsically safe 4-20mA position transmitter with HART® protocol

The gearing, potentiometer and resistance-to-current transducer circuit are clearly visible

The transducer is powered entirely from a two wire current loop and will generate a 4-20mA signal that will vary with changing valve position. A standard twisted pair of wires is all that is required and the signal is relatively immune to noise. The 4-20mA signal can be matched to the open and closed positions of the valve by adjusting the “zero” and “range” settings on the transducer. The latest versions allow this to be done by simply pushing and holding a button at each end of travel.

A resistance-to-current transducer circuit with a built in HART® facility permits data acquisition or transmission to and from the position transmitter. This is very useful for remote monitoring or calibration. Digital data is transmitted by superimposing it on top of the 4-20mA analogue signal. HART® stands for “Highway addressable remote transducer”. A hand held HART® calibrator can be connected to the cable at any point between the position transmitter and the control room. The hand held device can then be used to remotely calibrate the ends of travel and also input the date of calibration and valve tag number. The same device can be used to read valve position, calibration date and tag number from the position transmitter. This can be particularly useful if the position transmitter is located in a hazardous or physically inaccessible location. Ex certified versions of the hand held calibrator are available for use in hazardous areas.



E-training

K Controls designs and manufactures valve networking monitoring and control products:

Switchboxes
Control Monitors
Position Transmitters
Corrosion resistant
ATEX certified – gas + dust
High and low temperatures
IP68 for submersion
Low powered solenoids
Remote I/O compatible
AS-interface®
DeviceNet™
PROFIBUS® PA
FOUNDATION™ FIELDBUS
4-20mA + HART®
Wireless solutions
Linear or rotary adaptation

K Controls can also supply your positioner requirements

If you have any questions or comments, would like a colleague to receive this information or you would like the latest list of training documents, please use the contact details below:

K Controls Ltd
2 Crown Way
Crown Business Centre
Horton Road
West Drayton UB7 8HZ
United Kingdom

Phone:
+44 (0)1895 449601

Fax:
+44 (0)207 990 8111

E-mail:
sales@k-controls.co.uk

Web:
www.k-controls.co.uk

Blog:
www.k-controls.info

Visit us:
View a map

Transducers that operate entirely digitally are now available that use the PROFIBUS® or FOUNDATION™ Fieldbus protocols. These offer similar benefits to HART plus the possibility of multi dropping a number of position transmitters on a single fieldbus spur. Some electro-pneumatic positioners are available with integrated position transmitters although sometimes there is a preference for a separate unit driven by a separate linkage on the other side of the linear actuator yoke. This would enable the position transmitter to detect a failure in the positioner linkage. Some “smart” positioners have built in software that monitors various actuator and positioner parameters and selects an appropriate algorithm to optimise performance. FOUNDATION™ Fieldbus “smart” positioners are capable of local control (via internal function blocks) and this releases the remote controller to perform other functions. If FOUNDATION™ Fieldbus “smart” positioners are fitted to a control valve from the same manufacturer they are often programmed with detailed information about the characteristics of the valve itself and this can give better local control performance than a positioner sourced from a third party.

In summary electro pneumatic positioners with no local control, pneumatic positioners or control valves operated directly via I to P converters can all benefit from the data provided to a remote controller by a position transmitter to both improve the performance of the control loop over time and give early warning of deteriorating control valve performance.

Trademarks K Controls has used all reasonable resources and efforts to indicate and supply information regarding trademarks used in this document. The absence of a trademark identifier is not a representation that a particular word or technology is not a trademark. All trademarks are property of their respective owners. If we have failed to properly show a trademark, please e-mail us and we will attempt to correct it. The ownership of all trademarks referred to in this document is acknowledged.

Legal Disclaimer This document is written by K Controls for use by its clients. Although we make every reasonable attempt to verify the accuracy of the technical information and advice provided, we can take no responsibility for loss or damage resulting from its interpretation or application. K Controls is not in any way responsible, and has no legal liability, in respect of the contents of any other web site accessed via this document, nor for information provided via that site. All information accessed via links in this document is protected by international copyright laws and may not be reproduced in any form without the explicit written permission of the author. This E-mail and any files transmitted with it are confidential and may be legally privileged. It is intended solely for clients of K Controls Ltd. Any unauthorized recipient should advise K Controls immediately of the error.

Copyright K Controls Ltd 2010 - All rights reserved.